


- LADDER RACK
- 35' 3 SEC
- 14' ROOF
- 10' FOLDING
- FENDER STORAGE
- LFF: TRIPLE SCBA
- LFF: FUEL/SCBA COMBO
- RFF: TRIPLE (2 EXTINGUISHER)
- RFF: TRIPLE SCBA
- Hose Load**
- 1: 1200ft of 5"
- 2: 400ft of 2.5" PRE-CONNECT
- 3: 400ft of 2.5" PRE-CONNECT

Hale Omax 2000 single stage
Water Tank Capacity 1600 gal

Left Side Compartmentation			Volume
Comp't	Doors	Inside Dimensions	Volume
L1	Roll Up	56x60x24.25/10.25	41.5 CU FT
L2	Roll Up	64x28x10.25	10.6 CU FT
L3	Roll Up	53x60x24.25/10.25	39.3 CU FT
Right Side Compartmentation			Volume
Comp't	Doors	Inside Dimensions	Volume
R1	Roll Up	56x38x24.25	32.2 CU FT
R2	Roll Up	53x38x24.25	30.5 CU FT
A1 Compartmentation			Volume
Comp't	Doors	Opening Dimensions	Volume
A1	HINGE	42x18.25x11.25	4.9 CU FT
Total Volume			158.1 CU FT

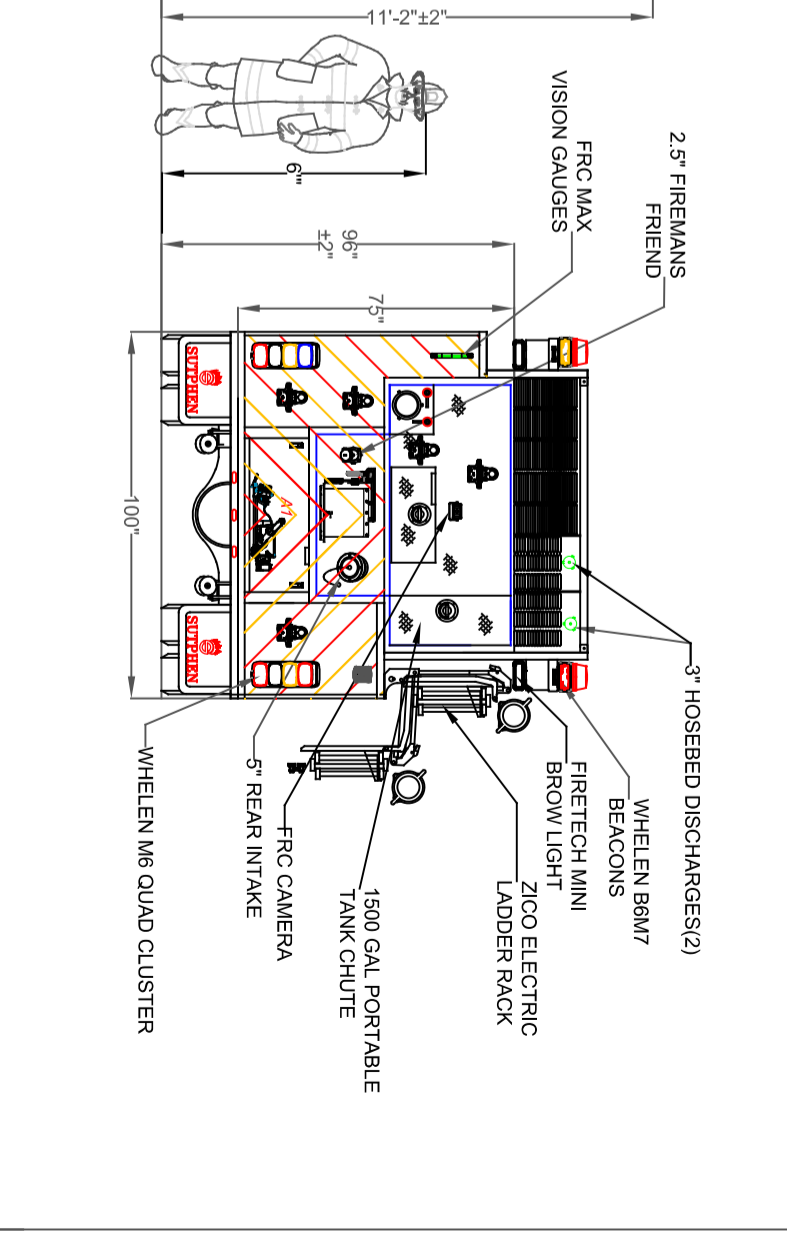

DIMENSIONS SHOWN ON THIS DRAWING ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS DURING CONSTRUCTION.		CUSTOMER APPROVAL	
IN THE EVENT OF A DISCREPANCY BETWEEN THE SUTPHEN SPECIFICATIONS AND DRAWING, THE SUTPHEN SPECIFICATIONS SHALL PREVAIL.		DRAWING IS FOR REFERENCE ONLY. SOME ITEMS PROPOSED MAY NOT BE SHOWN OR NOTED.	
NAME:	REV. N	ADDITION FROM MID INSPECTION	DATE: 06/11/24
TITLE:	REV. D	SLIDE MASTER IN R1	DATE: 09/26/2023
DATE:	REV. C	TFB H7 SIGNAL BOARD	DATE: 08/17/2023
	REV. A	CHANGES FROM PRE-CON	DATE: 09/23/2022
	REV.	DESCRIPTION	DATE
THIS PRINT IS PROVIDED ON A RESTRICTED BASIS AND IS NOT TO BE USED IN ANY WAY DETRIMENTAL TO THE INTEREST OF SUTPHEN CORPORATION.		DRAWN BY:	RAGHU
		DATE:	03/01/2022
		MFG FACILITY:	SUTPHEN EAST LAKE ARIEL, PA
		DWG. NO.:	HS 7529 GENESCO, NY
		CUSTOMER:	GENESCO FIRE DEPT., GENESCO, NY